

I/A Series® HARDWARE  
Product Specifications

HighFive PLC  
INVENYS PROCESS SYSTEMS

PSS 21H-2Z16 B4

FBM216 HART® Communication Redundant Input Interface Module

+86 13306036024



The FBM216 offers redundant modules for eight input channels, each accepting a 4 to 20mA analog signal or a digital HART® signal superimposed on a 4 to 20 mA analog signal.

#### FEATURES

Key features of the FBM216 module are:

- Eight analog input channels, each accepting one of the following inputs:
    - Standard 4 to 20 mA analog sensor signal
    - Digital HART Frequency Shift Keying (FSK) signal superimposed on a 4 to 20 mA analog signal.
  - Module pair offers redundancy at the FBM level
  - FSK modem dedicated to each input channel for bi-directional digital communications with a HART field device
  - Analog to digital conversion of each of the 4 to 20 mA input signal from the HART devices
- Support for the HART universal commands necessary to interface the field device with the VA Series® system database
  - Galvanic isolation of the group of 8 input channels from ground and module logic
  - Compact, rugged design suitable for enclosure in Class G3 (harsh) environments
  - High accuracy achieved by sigma-delta data conversions for each channel
  - Termination Assemblies (TAs) for locally or remotely connecting field wiring to the FBM216
  - Termination Assemblies for per channel internally and/or externally loop powered transmitters.

FOXBORO.

# HighFive PLC

[sales@5gplc.com](mailto:sales@5gplc.com)

+86 13306036024

## OVERVIEW

The FBM216 HART Communication Redundant Input Interface Module contains eight group-isolated input channels. The FBM216 supports any mix of standard 4 to 20 mA devices and HART devices.

A pair of modules combines to provide redundancy at the Fieldbus Module (FBM) level, with field inputs wired to one common termination assembly (see Figure 1). In this configuration, one FBM216 is the Master, and the other is the Tracker.

The FBM216 serves as a HART communications field device host, enabling the VA Series system to request and receive two digital messages per second from each field device. The message pass-through capability can be used to support HART universal, common practice, and device-specific commands, but not the burst communication mode. These commands are implemented using the Intelligent Field Device Configurator (IFDC – refer to PSS 21S-8A2 B3 for details).

The FBM216 provides a common source power supply to power all eight channels. Optionally, the channels can be powered by an external power supply, in which case a Cable Balun module is required to extend channel distance.

## HIGH ACCURACY

For high accuracy, the module incorporates a Sigma-Delta converter which can provide new analog input values for each channel every 100 milliseconds.

## COMPACT DESIGN

The FBM216 has a compact design, with a rugged extruded aluminum exterior for physical protection of the circuits. Enclosures specially designed for mounting the FBMs provide various levels of environmental protection, up to harsh environments per ISA Standard S71.04.

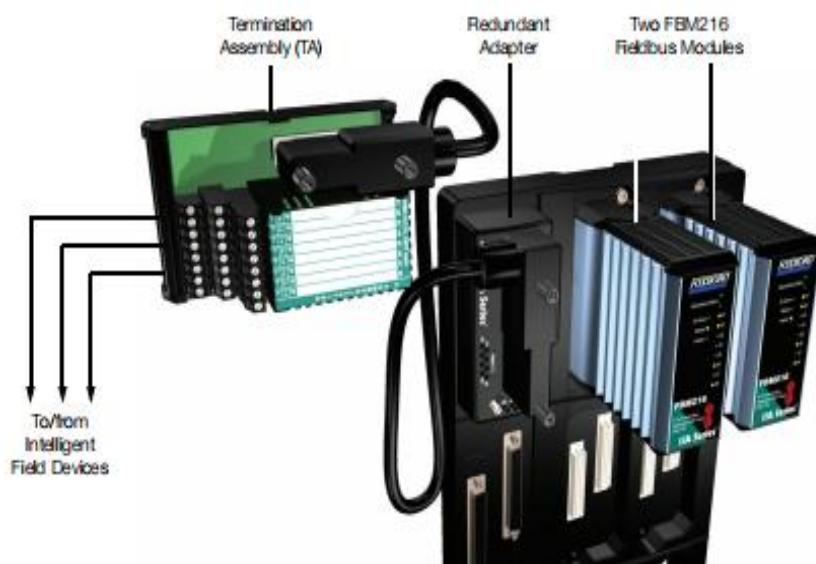


Figure 1. Redundant Module Configuration

**sales@5gplc.com**

**+86 13306036024**

## HIGH RELIABILITY

The redundancy of the module pair, coupled with the high coverage of faults, provides very high subsystem availability time.

Either module may be replaced without upsetting field input signals to the other module. A module can be removed or replaced without removing field device termination cabling, power, or communications cabling.

## REDUNDANT ANALOG INPUTS

For each input operation, identical reads are sent to both modules, fully exercising the Fieldbus and the logic circuitry of each module. Each input channel accepts an analog sensor input or a self-powered 4 to 20 mA source. Device power from each module is diode OR'd together in the redundant adapter to ensure redundant power.

The microprocessor of each module executes the analog I/O application program, plus security routines that validate the health of the FBM. Input channel security is enhanced by redundantly powering the input current loop from per-channel power supplies in each module of the pair.

## VISUAL INDICATORS

Light-emitting diodes (LEDs) incorporated into the front of the module provide visual indication of the module's operational and redundancy status, and communication activity on the channels. Two additional LEDs provide the master or tracker status of the modules.

## FIELDBUS COMMUNICATION

A Fieldbus Communication Module or a Control Processor interfaces the redundant 2 Mbps module Fieldbus used by the FBMs. The FBM216 module accepts communication from either pair A or B of the redundant 2 Mbps fieldbus – should one pair fail or be switched at the system level, the module continues communication over the active path.

The use of an external power supply common to two or more loops requires a Cable Balun module to maintain communication signal line balance.

## MODULAR BASEPLATE MOUNTING

The module mounts on a modular baseplate which accommodates up to four or eight FBMs. The modular baseplate is either DIN rail mounted or rack mounted, and includes signal connectors for redundant fieldbus, redundant independent dc power, and termination cables.

Redundant modules must be located in adjacent positions on the baseplate (positions 1 and 2, 3 and 4, 5 and 6, or 7 and 8). To achieve redundancy, a redundant adapter module is placed on the two adjacent baseplate termination cable connectors to provide a single termination cable connection (see Figure 1). A single termination cable connects from the redundant adapter to the associated termination assembly (TA).

## TERMINATION ASSEMBLIES

Field input signals connect to the FBM subsystem via DIN rail mounted TAs. The TAs used with the FBM216 are described in "TERMINATION ASSEMBLIES AND CABLES" on page 9.

# HighFive PLC

[sales@5gplc.com](mailto:sales@5gplc.com)



+86 13306036024

## CABLE BALUN MODULE

The Cable Balun module is used to maintain digital communication line balance for HART Transmitter to FBM loops that are powered from a common external power supply. This powering effectively connects one line of each loop together. Without the Baluns, in each loop so powered, the common connection at the external power supply, would cause near end crosstalk at the system end of the loop wiring cable. Loops using FBM internal power source do not require Baluns.

The Cable Balun module contains multiple Baluns. One Balun segment is interconnected in each loop powered from an external power supply per the diagram above. There is one Cable Balun module.

Cable Balun Module		
Module Model	Module Part No.	No. of Baluns in the Module
CBM-4	P0903SV	4

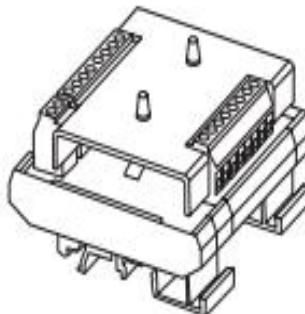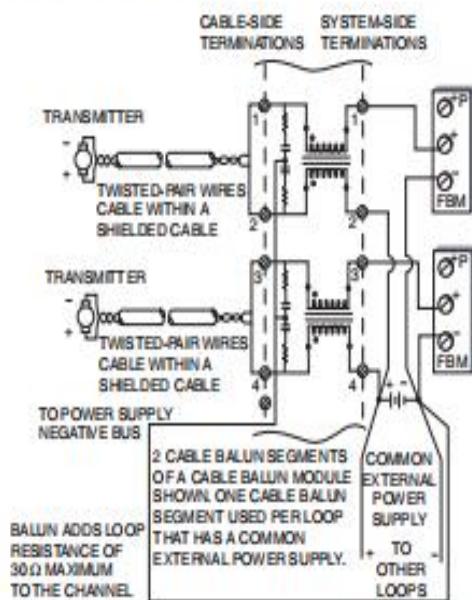

CABLE BALUN MODULE

Figure 2. Cable Balun Module

# HighFive PLC

FSS 21H-2Z16-B4

Page 5

**sales@5gplc.com**

## FUNCTIONAL SPECIFICATIONS

### Field Device Channels

#### VERSION SUPPORTED

HART Protocol v6

#### INTERFACE

8 group-isolated channels

#### COMMUNICATION TO THE DEVICE

Point-to-point, master/slave, asynchronous, half-duplex, at 1200 baud

#### ERROR CHECKING

Parity on each byte, and one CRC check byte

#### SPEED

2 messages per second

#### FASTEST ALLOWED ECB BLOCK PERIOD

500 msec

#### MAXIMUM DISTANCE (FBM216 TO FIELD DEVICE)

Meets HART FSK physical layer specification HCF\_SPEC-54, Revision 8.1 [up to 3030 m (10000 ft)]<sup>(1)</sup>

#### COMPLIANCE VOLTAGE

18 V dc minimum at 20.5 mA

#### CURRENT INPUTS

##### *Sense Resistor*

61.9 Ω nominal

##### *Total Input Resistance*

280 Ω minimum

##### *Analog Accuracy (Includes Nonlinearity)*

± 0.075%<sup>(2)</sup> of full scale

##### *Temperature Coefficient*

50 PPM/°C

##### *Resolution*

15 bits

##### *Update Rate*

100 ms

##### *Integration Time*

500 ms

#### Common Mode Rejection

>100 dB at 50 or 60 Hz

#### Normal Mode Rejection

>35 dB at 50 or 60 Hz

#### LOOP POWER SUPPLY PROTECTION

Each channel is galvanically group isolated, current limited, and voltage regulated.

All inputs are limited by their design to less than 30 mA with a single module installed (60 mA when redundant modules are installed). If the current limit circuit shorts out, the current is limited to about 85 mA.

#### MAXIMUM LOOP RESISTANCE

280 Ω (not including the field device)<sup>(3)</sup>

#### FBM INPUT IMPEDANCE

280 Ω minimum

#### FBM INTERNAL POWER FOR FIELD DEVICE

24 V dc ±10% common power supply for all channels. Loop load limited to one device per channel.

#### ISOLATION

The channels are not galvanically isolated from each other, but are galvanically isolated (both optical and transformer isolation) as a group from ground and module logic. Inputs use an internal FBM isolated power supply for field power. The module withstands, without damage, a potential of 600 V ac applied for one minute between the group isolated channels and earth (ground).

#### CAUTION

This does not imply that these channels are intended for permanent connection to voltages of these levels. Exceeding the limits for input voltages, as stated elsewhere in this specification, violates electrical safety codes and may expose users to electric shock.

(1) The maximum allowable distance decreases when the loop is operated through an intrinsic safety barrier. The maximum distance of the field device from the FBM is a function of compliance voltage, wire gauge and voltage drop at the device.

(2) Rev A through Rev F of FBM216 used with Rev A or Rev B of the Redundancy Adapter has an accuracy of 0.3% with external transmitter power or 0.6% with internal transmitter power. Use Rev G of FBM216 and Rev C of its Redundancy Adapter to obtain the accuracy of 0.075% for both power sources.

(3) In an intrinsic safety application, if a zener barrier is used between the FBM and the field device, the power supply must be set at 24 V dc +5%, -1%. There are no specific constraint with the use of galvanic barriers.

**+86 13306036024**

# HighFive PLC

**sales@5gplc.com**

## FUNCTIONAL SPECIFICATIONS (CONTINUED)

### Fieldbus Communication

Communicates with its associated FCM or FCP via the redundant 2 Mbps module Fieldbus

### Power Requirements

#### INPUT VOLTAGE RANGE (REDUNDANT)

24 V dc ±5%

#### CONSUMPTION

7 W (maximum)

#### HEAT DISSIPATION

4 W (maximum)

### Regulatory Compliance

#### ELECTROMAGNETIC COMPATIBILITY (EMC)

European EMC Directive 89/336/EEC

Meets: EN 50081-2 Emission standard

EN 50082-2 Immunity standard

EN 61326 Annex A (Industrial Levels)

CISPR 11, Industrial Scientific and Medical (ISM) Radio-frequency Equipment - Electromagnetic Disturbance Characteristics

- Limits and Methods of Measurement

Meets Class A Limits

IEC 61000-4-2 ESD Immunity

Contact 4 kV, air 8 kV

IEC 61000-4-3 Radiated Field Immunity

10 V/m at 80 to 1000 MHz

IEC 61000-4-4 Electrical Fast

Transient/Burst Immunity

2 kV on I/O, dc power and communication lines

IEC 61000-4-5 Surge Immunity

2kV on ac and dc power lines; 1kV on I/O and communications lines

IEC 61000-4-6 Immunity to Conducted Disturbances

10 V (rms) at 150 kHz to 80 MHz on I/O, dc power and communication lines

IEC 61000-4-8 Power Frequency Magnetic

Field Immunity

30 A/m at 50 and 60 Hz

### PRODUCT SAFETY

European Low Voltage Directive 73/23/EEC

#### SAFETY CERTIFICATION (FBM AND CABLE

#### BALUN)

Underwriters Laboratories (UL) for U.S. and Canada

UL/UL-C listed as suitable for use in

UL/UL-C listed Class I, Groups A-D;

Division 2; temperature code T4 enclosure

based systems. These modules are also UL

and UL-C listed as associated apparatus for

supplying non-incendive communication

circuits for Class I, Groups A-D hazardous

locations when connected to specified

I/A Series® processor modules as described

in the I/A Series DIN Rail Mounted

Subsystem User's Guide (B0400FA). Where

power is supplied by the FBM,

communications circuits also meet the

requirements for Class 2 as defined in

Article 725 of the National Electrical Code

(NFPA No.70) and Section 16 of the

Canadian Electrical Code (CSA C22.1).

Conditions for use are as specified in the

I/A Series DIN Rail Mounted Subsystem

User's Guide (B0400FA).

European Low Voltage Directive 73/23/EEC

and Explosive Atmospheres (ATEX) directive

94/9/EC

CENELEC (DEMKO) certified as EEx nA IIC

T4 for use in CENELEC certified Zone 2

enclosure certified as associated apparatus for

supplying non-incendive field circuits for

Zone 2, Group IIC, potentially explosive

atmospheres when connected to specified

I/A Series processor modules as described

in the I/A Series DIN Rail Mounted

Subsystem User's Guide (B0400FA). Also,

see Table 1 on page 10.

### Calibration Requirements

Calibration of the module or termination assembly is not required.

# HighFive PLC

FSS 21H-2216 b4

Page 7

**sales@5gplc.com**

## ENVIRONMENTAL SPECIFICATIONS<sup>(4)</sup>

### Operating

#### TEMPERATURE

##### Module

-20 to +70°C (-4 to +158°F)

##### Termination Assembly

##### PVC

-20 to +50°C (-4 to +122°F)

##### PA

-20 to +70°C (-4 to +158°F)

#### RELATIVE HUMIDITY

5 to 95% (noncondensing)

#### ALTITUDE

-300 to +3,000 m (-1,000 to +10,000 ft)

### Storage

#### TEMPERATURE

-40 to +70°C (-40 to +158°F)

#### RELATIVE HUMIDITY

5 to 95% (noncondensing)

#### ALTITUDE

-300 to +12,000 m (-1,000 to +40,000 ft)

### Contamination

Suitable for use in Class G3 (Harsh) environments as defined in ISA Standard S71.04, based on exposure testing according to EIA Standard 364-65, Class III.

### Vibration

7.5 m/S<sup>2</sup> (0.75 g) from 5 to 500 Hz

<sup>(4)</sup> The environmental limits of this module may be enhanced by the type of enclosure containing the module. Refer to the applicable Product Specification Sheet (PSS) which describes the specific type of enclosure that is to be used.

# HighFive PLC

**sales@5gplc.com**

## PHYSICAL SPECIFICATIONS

### Mounting

#### MODULE

FBM216 mounts on a modular baseplate. The baseplate can be mounted on a DIN rail (horizontally or vertically), or horizontally on a 19-inch rack using a mounting kit. Refer to PSS 21H-2WB B4 for details.

#### TERMINATION ASSEMBLY

The TA mounts on a DIN rail and accommodates multiple DIN rail styles including 32 mm (1.26 in) and 35 mm (1.38 in).

### Mass

#### MODULE

284 g (10 oz) approximate

#### TERMINATION ASSEMBLY

##### *Compression*

181 g (0.40 lb) approximate

##### *Ring Lug*

249 g (0.55 lb) approximate

### Dimensions – Module

#### HEIGHT

102 mm (4 in)

114 mm (4.5 in) including mounting lugs

#### WIDTH

45 mm (1.75 in)

#### DEPTH

104 mm (4.11 in)

### Dimensions – Termination Assembly

See page 11.

### Part Numbers

#### FBM216 MODULE

P0922V

#### TERMINATION ASSEMBLIES

See "FUNCTIONAL SPECIFICATIONS – TERMINATION ASSEMBLIES" on page 9

#### REDUNDANT ADAPTER

P0917XQ

### Termination Cables

#### CABLE LENGTHS

Up to 30 m (98 ft)

#### CABLE MATERIALS

Polyurethane or Hypalon®/XLP

#### TERMINATION CABLE TYPE

Types 1 – See Table 2 on page 10.

#### CABLE CONNECTION – TA

25-pin male D-subminiature

### Construction – Termination Assembly

#### MATERIAL

Polyvinyl Chloride (PVC), compression

Polyamide (PA), compression

PVC, ring lug

#### FAMILY GROUP COLOR

Green – communication

#### TERMINAL BLOCKS

3 tiers, 8 positions

### Field Termination Connections

#### COMPRESSION-TYPE ACCEPTED WIRING SIZES

##### *Solid/Stranded/AWG*

0.2 to 4 mm<sup>2</sup>/0.2 to 2.5 mm<sup>2</sup>/24 to 12 AWG

##### *Stranded with Ferrules*

0.2 to 2.5 mm<sup>2</sup> with or without plastic collar

#### RING-LUG TYPE ACCEPTED WIRING SIZES

#6 size connectors (0.375 in (9.5 mm))

0.5 to 4 mm<sup>2</sup>/22 AWG to 12 AWG